



# CELLFAN

## Compact High Performance Extract Unit

### Installation and Maintenance

### 1.0 Introduction

The Nuaire Cellfan Extract Fan provides continuous mechanical extract ventilation. The fan unit offers a 2 speed operation (Trickle and boost).

#### Fan Coding Description

**CELLFAN**

The unit casing is manufactured in galvatite steel and is a fully closed construction apart from the unit lid which acts as the access panel to wire the unit.

### 2.0 Installation

Installation must be carried out by competent personnel in accordance with the appropriate authority and conforming to all statutory governing regulations.

The fan unit must be fitted indoors, away from sources of water spray or steam generation. The fan can be installed at any angle using the mounting bracket supplied as part of the base plate of the unit.

It is assumed that a solid non-reverberant mounting position has been selected and the electrical mains wiring and any optional control wires have been made ready.


It is also assumed that compatible ductwork is already installed and ready to be connected to the 100mm dia discharge spigot and also the 100mm dia inlet spigots.

The unit is supplied with 100mm dia spigots on both the discharge and inlet for fitting during installation.

### 2.1 Unit Fixing

The base plate of the unit also doubles as the integral mounting bracket and can be offered up to position, the fixing points marked through and the full unit installed with 4 screws by others. (See figure 1).


Figure 1.

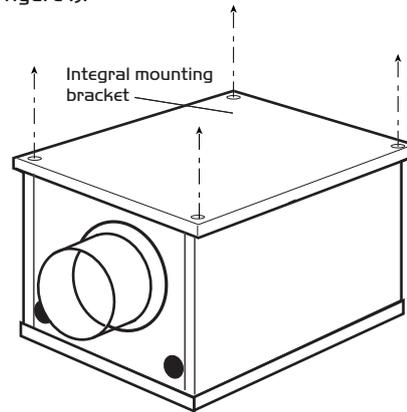

Please note that a clear space of at least 470 x 320mm is required to allow the cover to be removed and provide sufficient access for maintenance.

### 3.0 Dimensions (mm)

Figure 2.

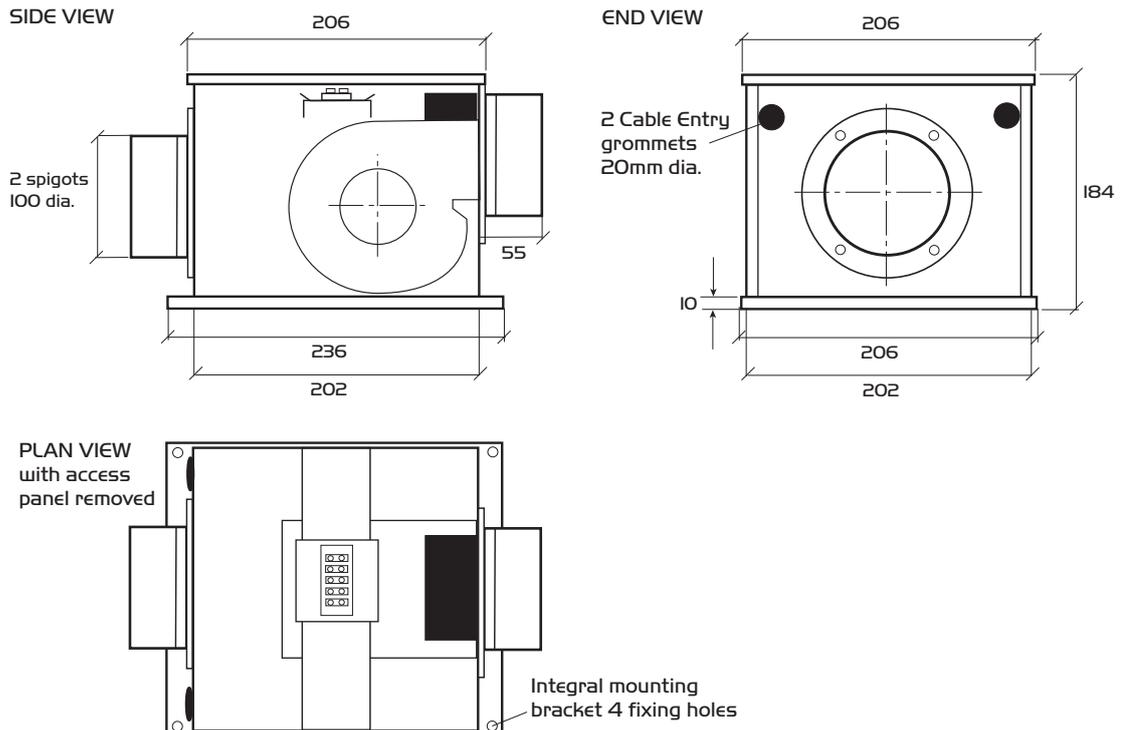

**IMPORTANT**

For good EMC engineering practice, any sensor cables or switched live cables should not be placed within 50mm of other cables or on the same metal cable tray as other cables.

**3.0 Electrical Information**


The fan is designed to be wired direct to the mains supply through a fused spur isolator (by others) and run continuously in the normal mode (which is the low speed background or trickle ventilation setting) with occasional boost airflow (high speed setting) as and when required.

**3.1 Electrical Connection**


With the unit fixed in position and working from underneath the installation, bring the external wiring through the chosen rubber cable entry grommet (See figure 3).

The unit must be earthed.

Figure 3.

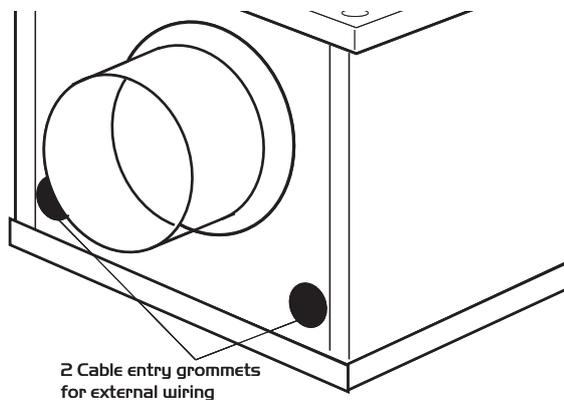

**3.2 Wiring**

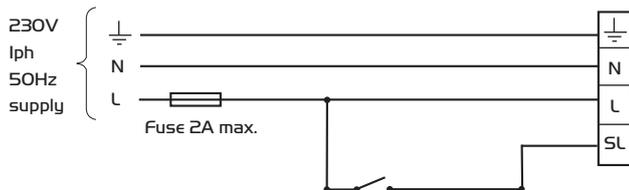

**4.0 Maintenance**

It is inevitable that even with filtered extract grilles as recommended in BRE digest 398 some dust, fluff etc. will pass through the filter, and which, if allowed, will build up internally on motors and impellers, shortening the life of the unit and, in severe cases, leading to overheating of the motors. Consequently, it is strongly recommended that all units are inspected and cleaned every six months.

**5.0 Cleaning**

Remove covers and carefully clean out interiors as necessary. Check for damage and security of components. Refit covers.

**6.0 Replacement of Parts**

Should any component need replacing Nuair keep extensive stocks for quick delivery. Ensure that the unit is electrically isolated, before carrying out any work.

When ordering spare parts, please quote the serial number of the unit and the ARC number of the purchase if possible. (This information will be available on the fan label).

**7.0 Warranty**

The 1 year warranty starts from the day of delivery and includes parts and labour. This warranty is conditional on planned maintenance being undertaken.

**8.0 Service Enquiries**

Nuair can assist you in all aspects of service. Our Technical Support department will be happy to provide any assistance required.

**Technical Support Department  
on 029 2085 8400**

## DECLARATION OF INCORPORATION AND INFORMATION FOR SAFE INSTALLATION, OPERATION AND MAINTENANCE

We declare that the machinery named below is intended to be assembled with other components to constitute a system of machinery. The machinery shall not be put into service until the system has been declared to be in conformity with the provisions of the EC Machinery Directive.

**Designation of machinery:** Extract Fan  
**Machinery Types:** Cellfan  
**Relevant EC Council Directives:** 2006/42/EC (Machinery Directive)  
**Applied Harmonised Standards:** BS EN ISO 12100-1, BS EN ISO 12100-2, EN294, EN60204-1, BS EN ISO 9001  
**Applied National Standards:** BS848 Parts One, Two and Five

**Signature of manufacture representatives:**

Name:	Position:	Date:
1) C. Biggs	Technical Director	20.07.07
2) A. Jones	Manufacturing Director	20.07.07




## INFORMATION FOR SAFE INSTALLATION, OPERATION AND MAINTENANCE OF NUAIRE VENTILATION EQUIPMENT

To comply with EC Council Directives 2006/42/EC Machinery Directive and 2004/108/EC (EMC).

To be read in conjunction with the relevant Product Documentation (see 2.1)

### 1.0 GENERAL

- 1.1 The equipment referred to in this Declaration of Incorporation is supplied by Nuairé to be assembled into a ventilation system which may or may not include additional components.
- The entire system must be considered for safety purposes and it is the responsibility of the installer to ensure that all of the equipment is installed in compliance with the manufacturers recommendations and with due regard to current legislation and codes of practice.

### 2.0 INFORMATION SUPPLIED WITH THE EQUIPMENT

- 2.1 Each item of equipment is supplied with a set of documentation which provides the information required for the safe installation and maintenance of the equipment. This may be in the form of a Data sheet and/or Installation and Maintenance instruction.
- 2.2 Each unit has a rating plate attached to its outer casing. The rating plate provides essential data relating to the equipment such as serial number, unit code and electrical data. Any further data that may be required will be found in the documentation. If any item is unclear or more information is required, contact Nuairé.
- 2.3 Where warning labels or notices are attached to the unit the instructions given must be adhered to.

### 3.0 TRANSPORTATION, HANDLING AND STORAGE

- 3.1 Care must be taken at all times to prevent damage to the equipment. Note that shock to the unit may result in the balance of the impeller being affected.
- 3.2 When handling the equipment, care should be taken with corners and edges and that the weight distribution within the unit is considered. Lifting gear such as slings or ropes must be arranged so as not to bear on the casing.
- 3.3 Equipment stored on site prior to installation should be protected from the weather and steps taken to prevent ingress of contaminants.

### 4.0 OPERATIONAL LIMITS

- 4.1 It is important that the specified operational limits for the equipment are adhered to e.g. operational air temperature, air borne contaminants and unit orientation.
- 4.2 Where installation accessories are supplied with the specified equipment eg. wall mounting brackets. They are to be used to support the equipment only. Other system components must have separate provision for support.
- 4.3 Flanges and connection spigots are provided for the purpose of joining to duct work systems. They must not be used to support the ductwork.
- 4.4 In the event of RF interference the fan may increase in speed or make high pitched noises. This is normal and will have no adverse effect on the fan. The speed and noise will return to normal once the interference has subsided.

### 5.0 INSTALLATION REQUIREMENTS

In addition to the particular requirements given for the individual product, the following general requirements should be noted.

- 5.1 Where access to any part of equipment which moves, or can become electrically live are not prevented by the equipment panels or by fixed installation detail (eg ducting), then guarding to the appropriate standard must be fitted.
- 5.2 The electrical installation of the equipment must comply with the requirements of the relevant local electrical safety regulations.
- 5.3 For EMC all control and sensor cables should not be placed within 50mm or on the same metal cable tray as 230V switched live, lighting or power cables and any cables not intended for use with this product.

### 6.0 COMMISSIONING REQUIREMENTS

- 6.1 General pre-commissioning checks relevant to safe operation consist of the following:
- Ensure that no foreign bodies are present within the fan or casing.
  - Check electrical safety. e.g. Insulation and earthing.
  - Check guarding of system.
  - Check operation of Isolators/Controls.
  - Check fastenings for security.
- 6.2 Other commissioning requirements are given in the relevant product documentation.

### 7.0 OPERATIONAL REQUIREMENTS

- 7.1 Equipment access panels must be in place at all times during operation of the unit, and must be secured with the original fastenings.
- 7.2 If failure of the equipment occurs or is suspected then it should be taken out of service until a competent person can effect repair or examination. (Note that certain ranges of equipment are designed to detect and compensate for fan failure).

### 8.0 MAINTENANCE REQUIREMENTS

- 8.1 Specific maintenance requirements are given in the relevant product documentation.
- 8.2 It is important that the correct tools are used for the various tasks required.
- 8.3 If the access panels are to be removed for any reason the electrical supply to the unit must be isolated.
- 8.4 A minimum period of two minutes should be allowed after electrical disconnection before access panels are removed. This will allow the impeller to come to rest.
- NB: Care should still be taken however since airflow generated at some other point in the system can cause the impeller to "windmill" even when power is not present.**
- 8.5 Care should be taken when removing and storing access panels in windy conditions.

Technical or commercial considerations may, from time to time, make it necessary to alter the design, performance and dimensions of equipment and the right is reserved to make such changes without prior notice.



Western Industrial Estate  
Caerphilly United Kingdom  
CF83 INA  
T: 029 2085 8400  
F: 029 2085 8444  
E: [info@nuaire.co.uk](mailto:info@nuaire.co.uk)  
W: [www.nuaire.co.uk](http://www.nuaire.co.uk)

Technical or commercial considerations may, from time to time, make it necessary to alter the design, performance and dimensions of equipment and the right is reserved to make such changes without prior notice.