

CVD100

Constant Volume Dampers

Installation and Maintenance



CE The EMC Directive 2014/30/EU
The Low Voltage Directive 2014/35/EU



1.0 Introduction

This constant volume damper is designed for installation with Nuaire's range of fans.

Units are rectangular in section, manufactured from grey /blue ABS plastic and designed to match a 100mm duct size.







The CVD100 damper will control the flowrate passing through it when the pressure drop across the damper is within the range stated in the performance envelope. e.g. 0 - 70 Pa not 300 - 370 Pa.

Two flow settings are available; trickle and boost. The damper will operate in the trickle setting when it is powered up and will go into the boost setting when a mains signal is received at the SL terminal or when the CVD-PIR (optional ancillary) is activated.


A run-on timer (adjustable between 1 to 60 minutes) will hold the damper in the boost setting for the preset time period.

The CVD100 has a controllable range of 5l/s to 25l/s with a typical accuracy of $\pm 2l/s$ if it is installed as prescribed in this document.

2.0 Top installation tips to ensure the best results from your CVD Damper

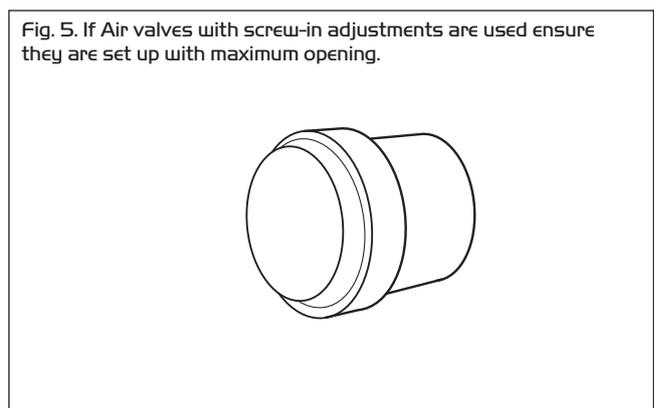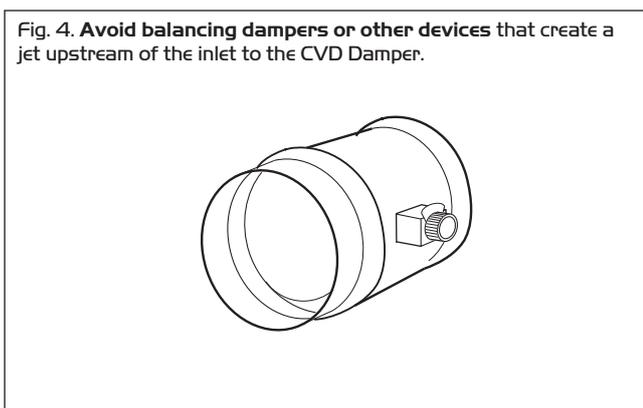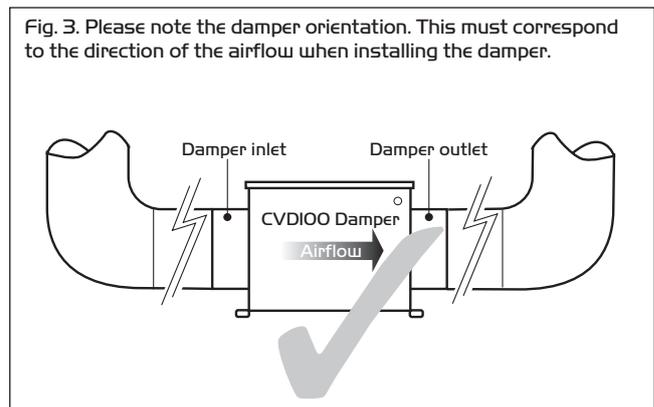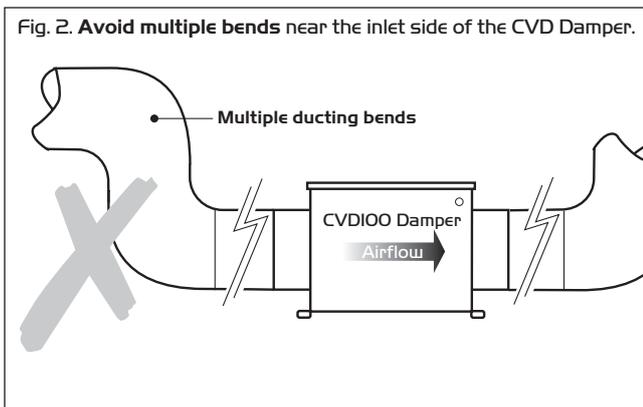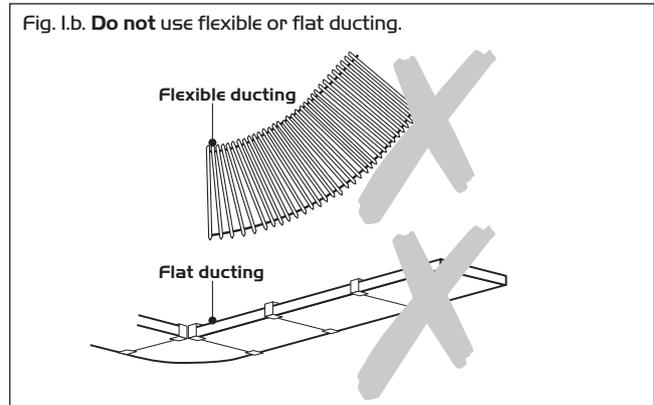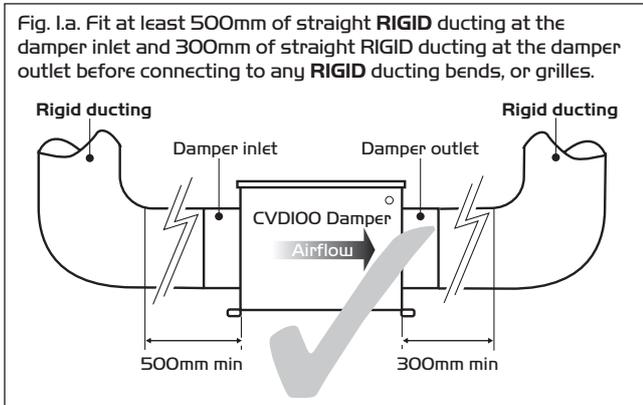

3.0 Dimensions (mm)

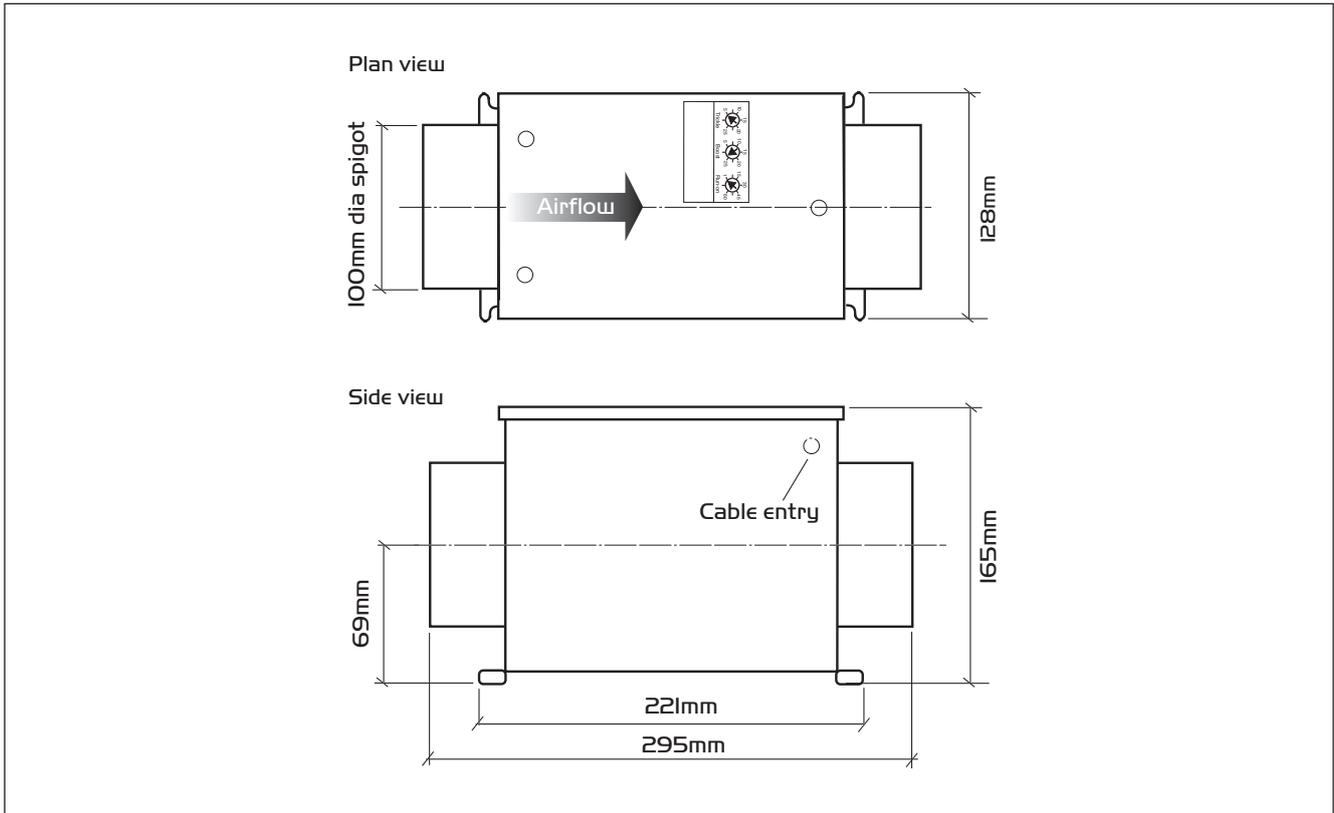

4.0 Handling

Handle the units carefully to avoid damage and distortion to moving parts.

5.0 System Design


A nominal pressure drop must be allowed in order to ensure adequate airflow through the damper. To ensure the airflow pattern through the damper produces consistent readings; the pressure drop across the damper should not exceed the recommended value. Recommended values are listed in the table following and show the performance envelope of each damper.

Nominal design pressure is the value needed to produce the maximum rated airflow for the damper. If the desired flowrate is less than the maximum, a lower design value may be used by reading off the lower curve of the appropriate chart. Please allow 30Pa (min).

Model code	Nominal design pressure drop	Maximum pressure across damper
CVDI00	60Pa	120Pa

To ensure the system produces the lowest energy usage, keep the duct velocity as low as possible; preferably below 5m/s.

Figure 6. Performance envelope for CVDI00.

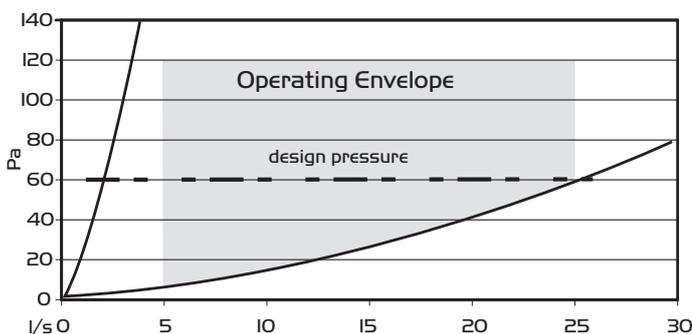

6.0 Installation

The installation must be carried out by competent personnel in accordance with the appropriate authority and conforming to all statutory and governing regulations.

IMPORTANT

The dampers must be installed indoors, away from sources of heat, steam or water spray. Operating ambient: 5-40°C, up to 95%RH (non condensing). CVDI00 is a double-insulated appliance and does not require earthing.

Failure to meet these conditions means the damper's calibration may be affected and would require careful commissioning to produce the desired flowrate. (See commissioning guide)

The CVDI00 damper must be located in an accessible location for service and maintenance as prescribed in the CDM regulation.

If the rigid ducting at the inlet and outlet of the damper are securely fixed to their support; the damper may be coupled directly to the ducting without additional fixing. If this is not the case; secure the damper to a rigid, vibration-free surface via the mounting points of the damper.

7.0 Electrical Wiring

Remove the three screws holding the top cover to gain access to wiring terminals. Use a screwdriver to knock out the thin plastic covering at the cable entry and fit a grommet to the hole.

Feed the cable through the grommetted hole and wire into the terminals as shown in figure 7.

Secure the cable using the cable clamp supplied.

Electrical rating: 230V~50Hz 3W.

It is recommended that the power is isolated from the damper until the system is ready to be commissioned.

IMPORTANT

Warning - Isolate the mains power before carrying out any electrical wiring.

The unit must be supplied via an all-pole isolator with at least 3mm gap as illustrated in the figure 4.

The recommended fuse rating is 1A.

A permanent mains supply must be connected for normal operation.

Figure 7. General wiring viewed with cover removed.


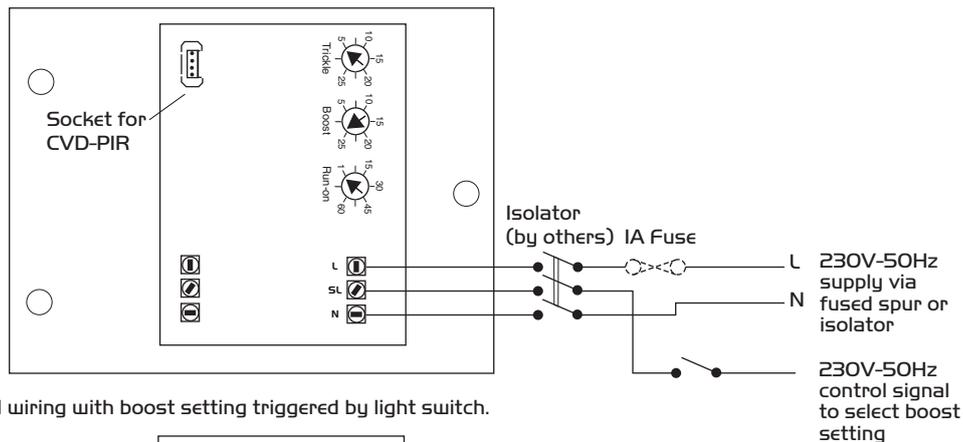


Figure 8. Typical wiring with boost setting triggered by light switch.

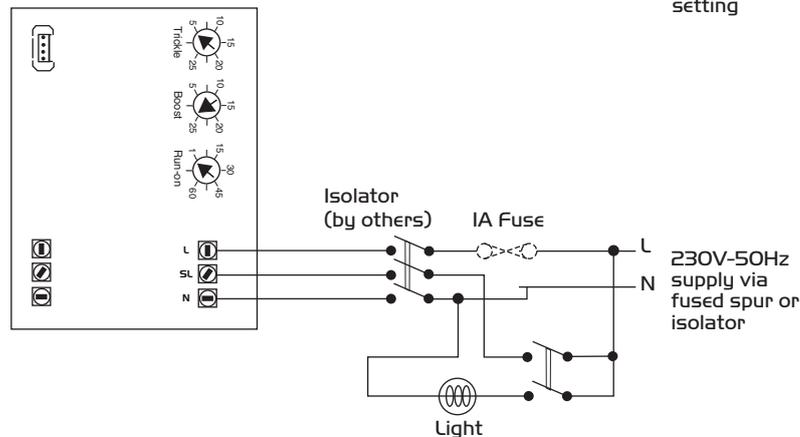

8.0 Operation

The trickle and boost flowrate together with the run-on time are adjustable via relevant potentiometers. These are accessible through the top cover without removing the lid.

Use a screwdriver to make the adjustment. Take care not to rotate the potentiometer beyond its limits of travel.

When power is connected; the damper will enter a test mode which takes approximately 2 minutes.

The damper will start operating normally after this period.

Figure 9. CVDI00 Settings. (see Note 1)



Note 1: These calibrated settings were obtained under laboratory conditions. Actual site conditions may cause these calibrations to drift. The markings are therefore for guidance only.

9.0 Maintenance

The damper should be inspected after the first 6 months of operation. Remove any accumulated dust and dirt using a soft brush and low power vacuum cleaner (e.g. a small battery operated model). Thereafter, inspect and clean the damper as site condition dictates.

We recommend that inspection should take place at least once a year.

10.0 Warranty

The damper is supplied with a 3 year warranty when used with Nuair fans. The first year includes parts and labour with the remaining period parts only. The warranty period begins on the date of delivery. If the damper is not used with Nuair fans the warranty period is 12 months parts only.

This warranty is void if the equipment is modified without authorisation, is incorrectly applied, misused, disassembled, or not installed, commissioned and maintained in accordance with the details contained in this manual and general good practice.

The product warranty applies to the UK mainland and in accordance with Clause 14 of our Conditions of Sale. Customers purchasing from outside of the UK should contact Nuair International Sales office for further details.

11.0 After Sales

For technical assistance or further product information, including spare parts and replacement components, please contact the After Sales Department.

Tel: 02920 858 400

12.0 Appendix I. Detailed operating sequence of CVD damper

On power up

The active LED will flash 3 times; after this the LED will be lit continuously if the switched live signal or the CVD-PIR is active (boost mode) and flash slowly if it is inactive (trickle mode). The damper will drive close for 12 seconds then open for 15 seconds. The damper will then drive close for 90 seconds to ensure it starts its operation from the fully closed position. Some noise may be heard during this period as the damper is driven against its end stop!

Warning – the unit must be connected permanently to the mains supply during normal operation. Use the switched live (SL) or the CVD-PIR to select boost setting. If the mains switch is switched on and off in normal operation, the noise generated during this start up routine may become a nuisance.

- The unit will start to measure the airflow after the initial power on routine. If the airflow is below the minimum calibration value (e.g. 5l/s for CVD100), it will drive open until it reaches half way through its allowable travel (approximately 15mm from the foam) and stop.
- When there is a consistent airflow greater than the minimum calibration (e.g. 5l/s for CVD100) for more than 10 seconds, the unit will begin to operate normally. The damper will be driven open or close depending on the measured airflow and the relevant set point.
- If the fan is stopped and the damper is less than half opened then the damper will travel to half opened position and stop. If the damper is at position beyond this, it will just stop. This is to make sure the damper is opened when the fan restart. The fan is considered to have restarted the conditions given in point 3 is met.
- The damper has a limited travel of approximately 35mm. Therefore it is essential that the gap between the foam and damper blade is less than 35mm to obtain full controllability before the damper is switched on. A maximum gap of about 20mm is recommended and would be the normal gap when the damper is delivered. Do not manually move the damper blade beyond its operating range.

Note 1:

The CVD volume control dials were calibrated in our laboratory under ideal flow conditions to give typical accuracy as given in table below. This should be used as a guide to the setting position. Site conditions may cause the calibration to drift; e.g. bends or inlet grille being too close or multiple bends. If this occurs; the trickle and boost set point should be adjusted up or down as necessary to produce the desired flowrate.

*Typical accuracy of the damper under ideal conditions.

CVD100+/-2l/s

Please see leaflet 671405 for guidance on commissioning the system and CVD dampers.

Technical or commercial considerations may, from time to time, make it necessary to alter the design, performance and dimensions of equipment and the right is reserved to make such changes without prior notice.